



BXUV.X795

Design/System/Construction/Assembly Usage Disclaimer

- Authorities Having Jurisdiction should be consulted in all cases as to the particular requirements covering the installation and use of UL Certified products, equipment, system, devices, and materials.
- Authorities Having Jurisdiction should be consulted before construction.
- Fire resistance assemblies and products are developed by the design submitter and have been investigated by UL for compliance with applicable requirements. The published information cannot always address every construction nuance encountered in the field.
- When field issues arise, it is recommended the first contact for assistance be the technical service staff provided by the product manufacturer noted for the design. Users of fire resistance assemblies are advised to consult the general Guide Information for each product category and each group of assemblies. The Guide Information includes specifics concerning alternate materials and alternate methods of construction.
- Only products which bear UL's Mark are considered Certified.

BXUV - Fire Resistance Ratings - ANSI/UL 263 Certified for United States

BXUV7 - Fire Resistance Ratings - CAN/ULC-S101 Certified for Canada

See General Information for Fire-resistance Ratings - ANSI/UL 263 Certified for United States Design Criteria and Allowable Variances


See General Information for Fire Resistance Ratings - CAN/ULC-S101 Certified for Canada Design Criteria and Allowable Variances

Design No. X795

November 20, 2017

Ratings — 1, 1-1/2, 2, 3 and 4 Hr

*** Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.**

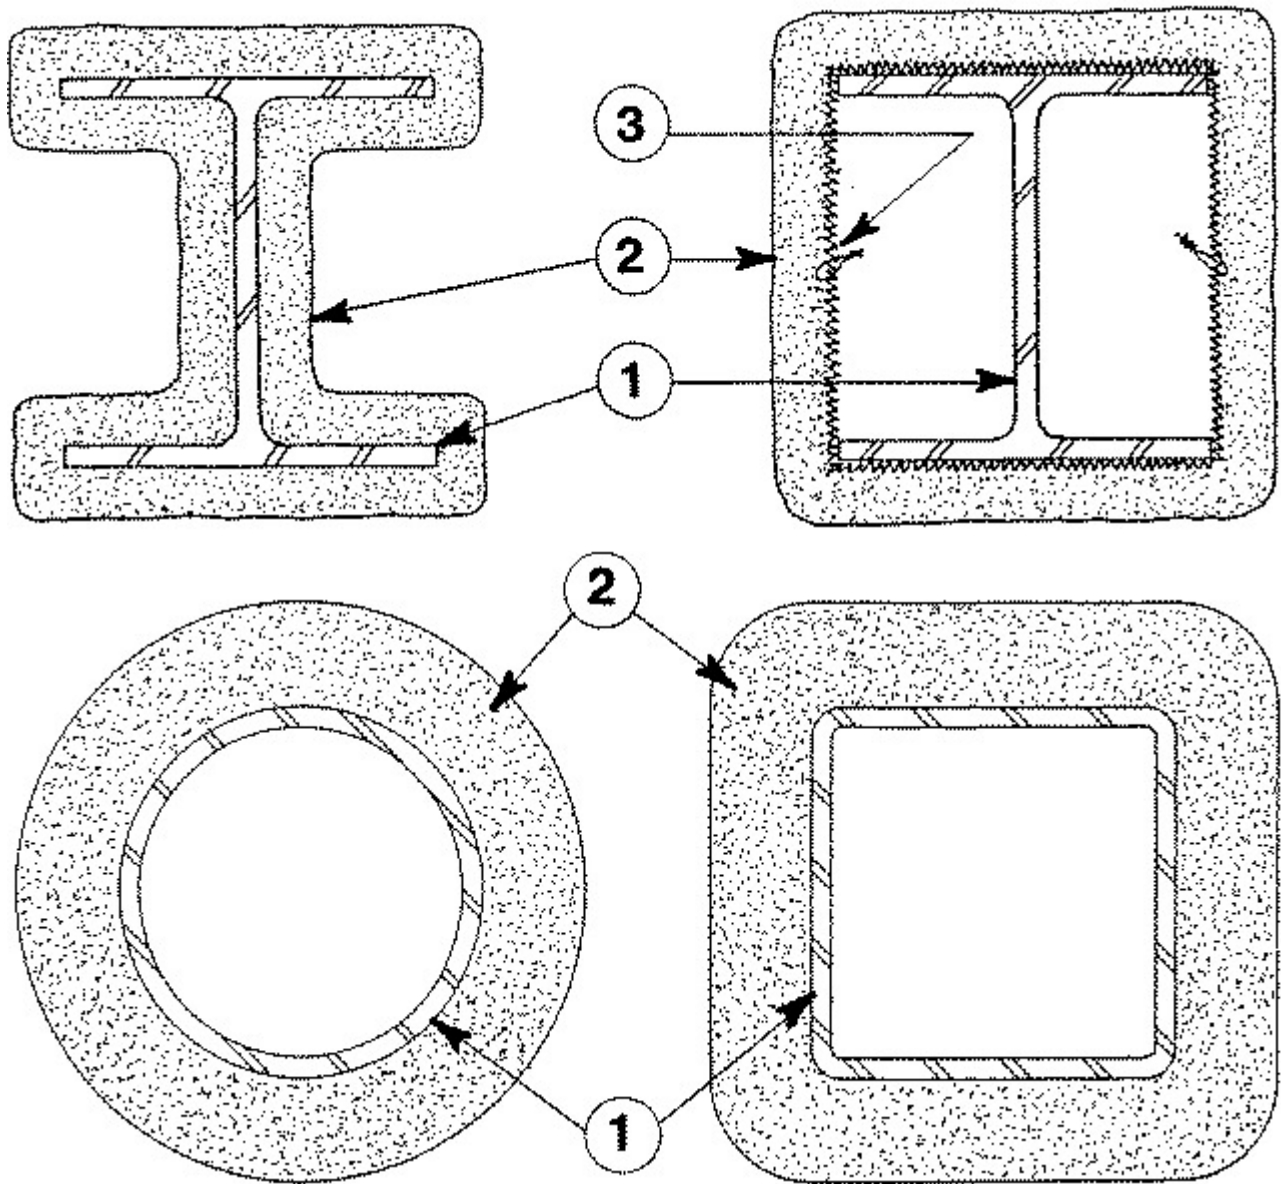

1. Steel Column, Steel Pipe or Steel Tube — Wide flange steel column (W) or steel circular pipe (SP) or steel square or rectangular tube (ST) with a W/D ratio ranging from 0.33 to 6.76 or an A/P ratio ranging from 0.18 to 2.0 respectively

2. Spray-Applied Fire Resistive Materials* — Applied by mixing with water and spraying in more than one coat to the thicknesses shown below, to steel surfaces which are clean and free of dirt, loose scale and oil. Min avg and min ind density of 40/36 pcf respectively for Types Avikote AV 650, Z-146, Z-146PC and Z-146T cementitious mixture. Min avg and min ind density of 50/45 pcf respectively for Type Avikote AV 800, Z-156, Z-156T and Z-156PC. For method of density determination, see Design Information Section, Sprayed Material.

The min thickness of Spray-Applied Fire Resistive Materials required for various fire resistance ratings of contours sprayed or boxed wide flange columns are shown in the table below:

The thickness of Spray-Applied Fire Resistive Materials to be applied to all surfaces of the column (Item 1) required for rating periods of 1, 1-1/2, 2, 3 and 4 h may be determined by the equation:

$$h = \frac{R}{1.05 (W/D) + 0.61}$$

Where:

h=Spray-Applied Fire Resistive Materials thickness in the range 0.25-3.875 in.

R=Fire resistance rating in hours (1-4 h)

D=Heated perimeter of steel column in inches

W=Weight of steel column in lbs per foot

W/D=0.33 to 6.76

As an alternate to the equation, the min thickness of Spray-Applied Fire Resistive Materials required for various fire resistance ratings of contours sprayed or boxed wide flange columns are shown on the table below:

Column Size In.	W/D Ratio	Min Thkns In.				
		1 Hr	1-1/2 Hr	2 Hr	3 Hr	4 Hr
W4x13	0.56	7/8	1-5/16	1-7/16	2-1/8	3
W5x16	0.55	7/8	1-5/16	1-1/2	2-1/8	3
W5x19	0.64	13/16	1-3/16	1-7/16	2-1/16	2-3/4
W6x9	0.34	1-1/16	1-7/16	1-1/2	2-1/4	3
W6x12	0.45	15/16	1-3/8	1-1/2	2-3/16	3
W6x15	0.43	1	1-7/16	1-1/2	2-3/16	3
W6x16	0.58	13/16	1-1/4	1-7/16	2-1/8	2-15/16
W6x20	0.56	7/8	1-5/16	1-7/16	2-1/8	3
W6x25	0.70	3/4	1-1/8	1-3/8	2	2-1/2
W8x10	0.33	1-1/16	1-7/16	1-1/2	2-1/4	3
W8x13	0.42	1	1-7/16	1-1/2	2-3/16	3
W8x15	0.48	15/16	1-3/8	1-1/2	2-3/16	3
W8x18	0.50	5/16	1-3/8	1-1/2	2-3/16	3
W8x21	0.58	13/16	1-1/4	1-7/16	2-1/8	2-15/16
W8x24	0.59	13/16	1-1/4	1-7/16	2-1/8	2-15/16
W8x28	0.69	3/4	1-3/16	1-3/8	2	2-1/2
W8x31	0.67	13/16	1-3/16	1-7/16	2-1/16	2-5/8
W8x35	0.75	3/4	1-1/8	1-3/8	2	2-5/16
W8x40	0.85	11/16	7/8	1-1/8	1-9/16	1-15/16
W8x48	1.00	5/8	7/8	1-1/8	1-9/16	1-15/16
W8x58	1.20	9/16	13/16	1-1/8	1-9/16	1-7/8
W8x67	1.37	1/2	3/4	1	1-1/2	1-7/8
W10x12	0.35	1-1/16	1-7/16	1-1/2	2-1/4	3
W10x15	0.43	1	1-7/16	1-1/2	2-3/16	3
W10x17	0.48	15/16	1-3/8	1-1/2	2-3/16	3
W10x19	0.54	7/8	1-5/16	1-1/2	2-1/8	3

W10x22	0.52	7/8	1-5/16	1-1/2	2-1/8	3
W10x26	0.61	13/16	1-1/4	1-7/16	2-1/8	2-14/16
W10x30	0.70	3/4	1-1/8	1-3/8	2	2-1/2
W10x33	0.66	13/16	1-3/16	1-7/16	2-1/16	2-11/16
W10x39	0.78	3/4	1-1/16	1-3/8	2	2-3/16
W10x45	0.89	11/16	7/8	1-1/8	1-9/16	1-15/16
W10x49	0.84	11/16	7/8	1-1/8	1-9/16	1-15/16
W10x54	0.92	11/16	7/8	1-1/8	1-9/16	1-15/16
W10x60	1.01	5/8	7/8	1-1/8	1-9/16	1-15/16
W10x68	1.15	9/16	7/8	1-1/8	1-9/16	1-7/8
W10x77	1.28	9/16	13/16	1-1/16	1-9/16	1-7/8
W10x88	1.45	1/2	3/4	1	1-7/16	1-13/16
W10x100	1.64	7/16	11/16	7/8	1-5/16	1-3/4
W10x112	1.81	7/16	5/8	13/16	1-1/4	1-5/8
W12x14	0.36	1-1/16	1-7/16	1-1/2	2-1/4	3
W12x16	0.41	1	1-7/16	1-1/2	2-1/4	3
W12x19	0.49	15/16	1-6/16	1-8/16	2-3/16	3
W12x22	0.56	7/8	1-5/16	1-7/16	2-1/8	3
W12x26	0.53	7/8	1-5/16	1-1/2	2-1/8	3
W12x30	0.61	13/16	1-1/4	1-7/16	2-1/8	2-14/16
W12x35	0.70	3/4	1-1/8	1-3/8	2	2-1/2
W12x40	0.73	3/4	1-1/8	1-3/8	2	2-3/8
W12x45	0.83	11/16	1-1/16	1-3/8	1-15/16	2
W12x50	0.91	11/16	7/8	1-1/8	1-9/16	1-15/16
W12x53	0.86	11/16	7/8	1-1/8	1-9/16	1-15/16
W12x58	0.93	11/16	7/8	1-1/8	1-9/16	1-15/16
W12x65	0.93	11/16	7/8	1-1/8	1-9/16	1-15/16
W12x72	1.02	5/8	7/8	1-1/8	1-9/16	1-15/16
W12x79	1.11	5/8	7/8	1-1/8	1-9/16	1-7/8
W12x87	1.22	9/16	13/16	1-1/16	1-9/16	1-7/8
W12x96	1.34	1/2	3/4	1	1-1/2	1-7/8

W12x106	1.47	1/2	3/4	15/16	1-7/16	1-13/16
W12x120	1.65	7/16	11/16	7/8	1-5/16	1-3/4
W12x136	1.86	7/16	5/8	13/16	1-3/16	1-9/16
W12x152	2.04	3/8	9/16	3/4	1-1/8	1-1/2
W12x170	2.26	3/8	9/16	11/16	1-1/16	1/3/8
W12x190	2.50	5/16	1/2	5/8	15/16	1-1/4
W12x210	2.73	5/16	7/16	9/16	7/8	1-3/16
W12x230	2.96	5/16	7/16	9/16	13/16	1-1/8
W12x252	3.20	5/16	7/16	9/16	13/16	1-1/16
W12x279	3.50	1/4	3/8	1/2	3/4	15/16
W12x305	3.76	1/4	3/8	1/2	11/16	15/16
W12x336	4.06	1/4	5/16	7/16	5/8	7/8
W14x22	0.48	15/16	1-3/8	1-1/2	2-3/16	3
W14x26	0.56	7/8	1-5/16	1-7/16	2-1/8	3
W14x30	0.56	7/8	1-5/16	1-7/16	2-1/8	3
W14x34	0.63	13/16	1-3/16	1-7/16	2-1/16	2-3/4
W14x38	0.71	3/4	1-1/8	1-3/8	2	2-7/16
W14x43	0.75	3/4	1-1/8	1-3/8	2	2-5/16
W14x48	0.84	11/16	7/8	1-1/8	1-9/16	1-15/16
W14x53	0.92	11/16	7/8	1-1/8	1-9/16	1-15/16
W14x61	0.93	11/16	7/8	1-1/8	1-9/16	1-15/16
W14x68	1.04	5/8	7/8	1-1/8	1-9/16	1-15/16
W14x74	1.12	9/16	7/8	1-1/8	1-9/16	1-7/8
W14x82	1.23	9/16	13/16	1-1/16	1-9/16	1-7/8
W14x90	1.08	5/8	7/8	1-1/8	1-9/16	1-15/16
W14x99	1.18	9/16	13/16	1-1/8	1-9/16	1-7/8
W14x109	1.29	9/16	13/16	1-1/16	1-9/16	1-7/8
W14x120	1.42	1/2	3/4	1	1-7/16	1-13/16
W14x132	1.56	1/2	11/16	15/16	1-3/8	1-13/16
W14x145	1.64	7/16	11/16	7/8	1-5/16	1-3/4
W14x159	1.78	7/16	5/8	13/16	1-1/4	1-5/8

W14x176	1.96	3/8	9/16	3/4	1-1/8	1-1/2
W14x193	2.14	3/8	9/16	3/4	1-1/16	1-7/16
W14x211	2.32	3/8	1/2	11/16	1	1-3/8
W14x233	2.55	5/16	1/2	9/16	7/8	1-1/4
W14x257	2.78	5/16	7/16	9/16	7/8	1-3/16
W14x283	3.03	5/16	7/16	9/16	13/16	1-1/16
W14x311	3.30	1/4	3/8	1/2	3/4	1
W14x342	3.58	1/4	3/8	1/2	11/16	15/16
W14x370	3.84	1/4	3/8	7/16	11/16	7/8
W14x398	4.09	1/4	5/16	7/16	5/8	7/8
W14x426	4.32	1/4	5/16	7/16	5/8	13/16
W14x455	4.59	1/4	5/16	3/8	9/16	3/4
W14x500	4.95	1/4	5/16	3/8	9/16	3/4
W14x550	5.34	1/4	5/16	3/8	1/2	11/16
W14x605	5.82	1/4	5/16	5/16	1/2	5/8
W14x665	6.21	1/4	5/16	5/16	7/16	9/16
W14x730	6.76	1/4	5/16	5/16	3/8	9/16
W16x26	0.50	15/16	1-3/8	1-1/2	2-3/16	3
W16x31	0.59	13/16	1-1/4	1-7/16	2-1/8	2-15/16
W16x36	0.62	13/16	1-1/4	1-7/16	2-1/16	2-13/16
W16x40	0.69	3/4	1-3/16	1-3/8	2	2-1/2
W16x45	0.77	3/4	1-1/16	1-3/8	2	2-1/4
W16x50	0.85	11/16	7/8	1-1/8	1-9/16	1-15/16
W16x57	0.96	5/8	7/8	1-1/8	1-9/16	1-15/16
W16x67	0.94	11/16	7/8	1-1/8	1-9/16	1-15/16
W16x77	1.07	5/8	7/8	1-1/8	1-9/16	1-15/16
W16x89	1.22	9/16	13/16	1-1/16	1-9/16	1-7/8
W16x100	1.37	1/2	3/4	1	1-1/2	1-7/8
W18x35	0.60	13/16	1-1/4	1-7/16	2-1/8	2-14/16
W18x40	0.69	3/4	1-3/16	1-3/8	2	2-1/2
W18x46	0.79	3/4	1-1/16	1-3/8	2	2-1/8

W18x50	0.78	3/4	1-1/16	1-3/8	2	2-3/16
W18x55	0.85	11/16	7/8	1-1/8	1-9/16	1-15/16
W18x60	0.92	11/16	7/8	1-1/8	1-9/16	1-15/16
W18x65	1.00	5/8	7/8	1-1/8	1-9/16	1-15/16
W18x71	1.08	5/8	7/8	1-1/8	1-9/16	1-15/16
W18x76	0.97	5/8	7/8	1-1/8	1-9/16	1-15/16
W18x86	1.09	5/8	7/8	1-1/8	1-9/16	1-15/16
W18x97	1.22	9/16	13/16	1-1/16	1-9/16	1-7/8
W18x106	1.33	9/16	3/4	1	1-1/2	1-7/8
W18x119	1.48	1/2	3/4	15/16	1-7/16	1-13/16
W21x44	0.67	13/16	1-3/16	1-7/16	2-1/16	2-5/8
W21x50	0.75	3/4	1-1/8	1-3/8	2	2-5/16
W21x57	0.86	11/16	7/8	1-1/8	1-9/16	1-15/16
W21x62	0.85	11/16	7/8	1-1/8	1-9/16	1-15/16
W21x68	0.93	11/16	7/8	1-1/8	1-9/16	1-15/16
W21x73	0.99	10/16	7/8	1-1/8	1-9/16	1-15/16
W21x83	1.12	9/16	7/8	1-1/8	1-9/16	1-7/8
W21x93	1.24	9/16	13/16	1-1/16	1-9/16	1-7/8
W21x101	1.13	9/16	7/8	1-1/8	1-9/16	1-7/8
W21x111	1.24	9/16	13/16	1-1/16	1-9/16	1-7/8
W21x122	1.35	1/2	3/4	1	1-1/2	1-7/8
W21x132	1.45	1/2	3/4	1	1-7/16	1-13/16
W21x147	1.61	7/16	11/16	7/8	1-5/16	1-3/4
W24x55	0.75	3/4	1-1/8	1-3/8	2	2-5/16
W24x62	0.84	11/16	7/8	1-1/8	1-9/16	1-15/16
W24x68	0.84	11/16	7/8	1-1/8	1-9/16	1-15/16
W24x76	0.93	11/16	7/8	1-1/8	1-9/16	1-15/16
W24x84	1.02	5/8	7/8	1-1/8	1-9/16	1-15/16
W24x94	1.14	9/16	7/8	1-1/8	1-9/16	1-7/8
W24x104	1.07	5/8	7/8	1-1/8	1-9/16	1-15/16
W24x117	1.20	9/16	13/16	1-1/8	1-9/16	1-7/8

W24x131	1.33	9/16	3/4	1	1-1/2	1-7/8
W24x146	1.48	1/2	3/4	15/16	1-7/16	1-13/16
W24x162	1.63	7/16	11/16	7/8	1-5/16	1-3/4
W27x84	0.92	11/16	7/8	1-1/8	1-9/16	1-15/16
W27x94	1.03	5/8	7/8	1-1/8	1-9/16	1-15/16
W27x102	1.11	5/8	7/8	1-1/8	1-9/16	1-7/8
W27x114	1.23	9/16	13/16	1-1/16	1-9/16	1-7/8
W27x146	1.35	1/2	3/4	1	1-1/2	1-7/8
W27x161	1.48	1/2	3/4	15/16	1-7/16	1-13/16
W27x178	1.63	7/16	11/16	7/8	1-5/16	1-3/4
W30x99	1.00	5/8	7/8	1-1/8	1-9/16	1-15/16
W30x108	1.09	5/8	7/8	1-1/8	1-9/16	1-15/16
W30x116	1.16	9/16	7/8	1-1/8	1-9/16	1-7/8
W30x124	1.24	9/16	13/16	1-1/16	1-9/16	1-7/8
W30x132	1.32	9/16	13/16	1-1/16	1-9/16	1-7/8
W30x173	1.47	1/2	3/4	15/16	1-7/16	1-13/16
W30x191	1.62	7/16	11/16	7/8	1-5/16	1-3/4
W30x211	1.76	7/16	5/8	7/8	1-1/4	1-11/16
W33x118	1.08	5/8	7/8	1-1/8	1-9/16	1-15/16
W33x130	1.18	9/16	13/16	1-1/8	1-9/16	1-7/8
W33x141	1.28	9/16	13/16	1-1/16	1-9/16	1-7/8
W33x152	1.37	1/2	3/4	1	1-1/2	1-7/8
W33x201	1.58	1/2	11/16	15/16	1-3/8	1-13/16
W33x221	1.73	7/16	5/8	7/8	1-1/4	1-11/16
W33x241	1.87	7/16	5/8	13/16	1-3/16	1-9/16
W36x135	1.15	9/16	7/8	1-1/8	1-9/16	1-7/8
W36x150	1.27	9/16	13/16	1-1/16	1-9/16	1-7/8
W36x160	1.35	1/2	3/4	1	1-1/2	1-7/8
W36x170	1.43	1/2	3/4	1	1-7/16	1-13/16
W36x182	1.52	1/2	11/16	15/16	1-3/8	1-13/16
W36x194	1.62	7/16	11/16	7/8	1-5/16	1-3/4

W36x210	1.74	7/16	5/8	7/8	1-1/4	1-11/16
W36x230	1.69	7/16	11/16	7/8	1-5/16	1-11/16
W36x245	1.79	7/16	5/8	13/16	1-1/4	1-5/8
W36x260	1.90	7/16	5/8	13/16	1-3/16	1-9/16
W36x280	2.03	3/8	9/16	3/4	1-1/8	1-1/2
W36x300	2.17	3/8	9/16	3/4	1-1/16	1-7/16

The hourly rating of the structural member is dependent upon the ratio of A/P and the thickness of Spray-Applied Fire Resistive Materials, where A is the cross sectional area of the pipe or tube and P is the heated perimeter.

The A/P ratio of a circular pipe is determined by:

$$A/P \text{ pipe} = \frac{t(d - t)}{d}$$

Where:

d=the outer diameter of the pipe (in.)

t=the wall thickness of the pipe (in.)

The A/P ratio of a rectangular or square tube is determined by:

$$A/P \text{ tube} = \frac{t(a + b - 2t)}{a + b}$$

Where:

a=the outer width of the tube (in.)

b=the outer length of the tube (in.)

t=the wall thickness of the tube (in.)

The thickness of Spray-Applied Fire Resistive Materials for ratings of 3/4, 1, 1-1/2, 2, 3 and 4 h of a steel pipe or tube can be determined by the equation:

$$h = \frac{R - 0.2}{4.43 (A/P)}$$

Where:

R=the hourly rating (hrs)

h=Spray-Applied Fire Resistive Materials thickness in the range 0.25-3.875 in.

As an alternate to the equation, the min thickness of Spray-Applied Fire Resistive Materials required for various fire resistance ratings of contour sprayed steel pipes or tubes are shown on the table below:

Column Size In.	Min Thkns In.				
	1 Hr	1-1/2 Hr	2 Hr	3 Hr	4 Hr
ST 4x4x3/16 in.	1	1-7/16	1-13/16	2-9/16	3-5/16

ST 4x4x5/16 in.	5/8	1-1/16	1-7/16	2-3/16	2-15/16
ST 4x4x3/8 in.	9/16	7/8	1-1/4	1-7/8	2-9/16
ST 4x4x1/2 in.	7/16	11/16	15/16	1-7/16	2
ST 20x20x3/4 in.	1/4	3/8	9/16	7/8	1-3/16
ST 20x20x1 in.	1/4	5/16	7/16	11/16	15/16
ST 20x20x1-1/12 in.	1/4	1/4	5/16	1/2	5/8
ST 20x20x1-3/4 in.	1/4	1/4	5/16	7/16	9/16
ST 32x32x1-1/4 in.	1/4	1/4	3/8	9/16	3/4
ST 32x32x1-1/2 in.	1/4	1/4	5/16	1/2	5/8
ST 32x32x1-3/4 in.	1/4	1/4	1/4	7/16	9/16
ST 32x32x2 in.	1/4	1/4	1/4	3/8	1/2
ST 36x24x1/2 in.	3/8	5/8	7/8	1-5/16	1-3/4
SP 4x0.237 in.	13/16	1-3/8	1-13/16	2-5/8	3-1/2
SP 6x0.432 in.	1/2	3/4	1-1/16	1-5/8	2-3/16
SP 6x0.864 in.	1/4	3/8	9/16	7/8	1-3/16
SP 8x0.322 in.	5/8	1	1-5/16	2-1/16	2-13/16
SP 10x0.5 in	3/8	5/8	7/8	1-3/8	1-13/16

ARABIAN VERMICULITE INDUSTRIES — Types Z-146, Z-146 NPP, ZZ-146PC, Z-146T, Z-156, Z-156PC, Z-156T, AV 650, AV 800. Investigated for exterior use.

GCP KOREA INC — Types Z-146, Z-146 NPP, Z-146PC, Z-146T, Z-156, Z-156PC, Z-156T. Investigated for exterior use.

GCP APPLIED TECHNOLOGIES INC — Types Z-146, Z-146 NPP, Z-146PC, Z-146T, Z-156, Z-156PC, Z-156T. Investigated for exterior use.

3. **Metal Lath** — (Optional for contour application) — 3.4 lbs per sq yd galv or painted expanded steel lath. Lath shall be lapped 1 in. and tied together with No. 18 SWG galv steel wire spaced vertically 6 in. O.C.

*** Indicates such products shall bear the UL or cUL Certification Mark for jurisdictions employing the UL or cUL Certification (such as Canada), respectively.**

Last Updated on 2017-11-20

The appearance of a company's name or product in this database does not in itself assure that products so identified have been manufactured under UL's Follow-Up Service. Only those products bearing the UL Mark should be considered to be Certified and covered under UL's Follow-Up Service. Always look for the Mark on the product.

UL permits the reproduction of the material contained in the Online Certification Directory subject to the following conditions: 1. The Guide Information, Assemblies, Constructions, Designs, Systems, and/or Certifications (files) must be presented in their entirety and in a non-misleading manner, without any manipulation of the data (or drawings). 2. The statement "Reprinted from the Online Certifications Directory with permission from UL" must appear adjacent to the extracted material. In addition, the reprinted material must include a copyright notice in the following format: "© 2020 UL LLC"